



Digital electropneumatic process controller for integrated mounting on process control valves

- Compact and robust stainless steel design
- Easy start-up via Tune function for position and process controller
- Contact-free position sensor
- Integrated pilot air duct with spring chamber aeration
- PROFIBUS DP-V1, EtherNet/IP, PROFINET, Modbus TCP or bÜS (Bürkert System Bus)

Product variants described in the data sheet may differ from the product presentation and description.

Can be combined with

	Type 2301 Pneumatically operated 2-way Globe Control Valve	▶
	Type 2300 Pneumatically operated 2-way angle seat control valve ELEMENT	▶
	Type 2103 2/2-way diaphragm valve with pneumatic stainless steel actuator (Type ELE- MENT) for decentralised automation	▶
	Type 8202 pH or redox potential transmitter, ELEMENT design	▶
	Type 8045 Electromagnetic insertion flowmeter	▶
	Type 8619 multiCELL – multi-channel/ multi-function transmitter/ controller	▶
	Type 8228 Inductive conductivity meter, ELEMENT Design	▶

Type description

The compact process controller device Type 8693 is optimised for integrated mounting on the pneumatic actuators in the Type 23xx/2103 process valve series and is specially designed for the requirements of a hygienic process environment. The actual value of the process factor is directly supplied to the device as 4 - 20 mA, PT100 or a frequency signal. The process controller calculates the setpoint for the subordinated positioner based on the variance comparison. Via the analogue feedback, all analogue values on the control levels can be transferred.

The integrated diagnostic functions are used to monitor control valve operating conditions. Valve diagnostic messages via status signals are issued in accordance with NE107 (NAMUR) and recorded as historical entries. The parameterisation of process controller and positioner can be carried out automatically. The easy operation and the selection of additional software functions are carried out either via the large graphic display with backlight and keypad or via COMMUNICATOR.

The positioner registers the valve position without deterioration via a contact-free, analogue position sensor. The actuation of single or double-acting actuators is carried out without internal air consumption. Communication interfaces such as PROFIBUS DP-V1, EtherNet/IP, PROFINET, Modbus TCP, bÜS (based on CANopen) and analogue as well as digital feedback are optionally available.

Table of contents

1. General technical data	3
2. Approvals and conformities	5
2.1. General notes	5
2.2. Conformity	5
2.3. Standards	5
2.4. Explosion protection	5
2.5. North America (USA/Canada)	5
2.6. Others	5
China Compulsory Certification (CCC)	5
3. Materials	6
3.1. Material specifications	6
4. Dimensions	6
4.1. Multipole version	6
4.2. Cable gland version	6
4.3. Mounting on control valves of actuator series Type 23xx, actuator size 70/90/130/225 mm	7
4.4. Mounting on control valves of actuator series Type 27xx, actuator size 175/225 mm	8
5. Device/Process connections	9
5.1. Electrical connections	9
Multipole connection	9
Cable gland	10
PROFIBUS DP connection	10
EtherNet/IP, PROFINET, Modbus TCP connection	11
Bürkert system bus (bÜS) connection	12
6. Performance specifications	13
6.1. Signal flow diagram	13
Process control circuit	13
Position control loop	13
Additional software options of the TopControl process controller Type 8693	13
6.2. Interface diagram	14
Version without fieldbus communication	14
Version with fieldbus communication	14
7. Product installation	15
7.1. Combination options with pneumatic process valves	15
8. Ordering information	16
8.1. Bürkert eShop	16
8.2. Bürkert product filter	16
8.3. Ordering chart	16
8.4. Ordering chart accessories	18
Standard accessories	18
Adapter kits	18

1. General technical data

Product properties	
Dimensions	Further information can be found in chapter "4. Dimensions" on page 6.
Material	
Body	PPS, stainless steel
Seal	EPDM
Cover	PC
Operation	
Display	Graphic display with backlighting and intuitive menu navigation
Operating keys	Membrane keypad with 4 keys
Service interface	Connected to PC via USB connection
Configuration tool	Bürkert Communicator PACTware (only for device versions with PROFIBUS, resp. analogue version with serial interface)
Commissioning	
Initialisation positioner/process controller	Automatic by P.TUNE function (self-optimisation of PID parameter)
Manual operation of pilot valve	In manual mode via push-button on control panel
Status display	
Display of device and valve status	LEDs (colours according to NAMUR), only valid for Ethernet and bÜS versions
Communication	
Fieldbus	EtherNet/IP, PROFINET, Modbus TCP, PROFIBUS DP-V1
Digital	Bürkert system bus (bÜS) (based on CANopen)
Performance data	
Position sensor	
Measuring principle	Inductive
Position detection module	Contactless analogue position sensor (wear-free)
Stroke range	
Valve spindle	3...45 mm
Electrical data	
Operating voltage	24 V DC $\pm$ 10 % UL: NEC Class 2
Residual ripple	10 %, no technical DC voltage
Power consumption	< 5 W
Protection class	III according to DIN EN 61140 (VDE 0140 - 1)
Input/Output	
Digital input	1 digital input, 0...5 V = log „0“, 10...30 V = log „1“
Digital output	2 digital outputs (optional), galvanically isolated
Current limitation	100 mA, in case of overload, the output is switched off and cyclically switched on again to check for still existing overload.
Analogue output	1 output (optional) 0/4...20 mA, 0...5/10 V
Input data setpoint and actual value	
Setpoint signal	
Setpoint value setting default	0/4...20 mA 0...5/10 V
Input resistance	0/4...20 mA, 180 Ω 0...5/10 V, 19 k Ω
Setpoint signal	
Setting 4...20 mA	180 Ω input resistance
Frequency setting	17 k Ω input resistance, 0...1000 Hz
Setting Pt 100	- 20...+ 220 °C, resolution < 0.1 °C
Electrical connection	
Multipole version	M12, 8-pin resp. 4-pin or 5-pin according to device version (see "5. Device/Process connections" on page 9)
Cable gland version	2x M16 $\times$ 1.5 (cable $\varnothing$ 5...10 mm) with terminals for cable cross-sections 0.14...1.5 mm ²

Pneumatic data

Control medium

Dust content	Class 7 (< 40 µm particle size)
Particle density	Class 5 (< 10 mg/m ³)
Pressure dew point	Class 3 (← 20 °C)
Oil content	Class X (< 25 mg/ m ³)

Air intake filter

Exchangeable

Mesh size	~0.1 mm
-----------	---------

Supply pressure

Low air capacity	0...7 bar ^{1.)}
High air capacity	3...7 bar
Pilot air port	Threaded connection G 1/8, stainless steel

Positioning system

Low air capacity

Single-acting and double-acting	7 l _N /min for aeration and ventilation (Q _{Nn} value according to definition at pressure drop from 7 to 6 bar abs)
Actuator series/size	Type 23xx, actuator Ø 70/90 mm

High air capacity

Single-acting	130 l _N /min for aeration and ventilation (Q _{Nn} value according to definition at pressure drop from 7 to 6 bar abs)
Actuator series/size	Type 23xx, actuator Ø 70/90/225 mm Type 27xx, actuator Ø 175/225 mm

Approvals and conformities

Explosion protection

Ignition protection class	II 3D Ex tc IIIC T135 °C Dc II 3G Ex ec IIC T4 Gc
ATEX	BVS 14 ATEX E 008 X II 3D Ex tc IIIC T135 °C Dc II 3G Ex ec IIC T4 Gc
IECEx	IECEx BVS 14.0009 X Ex tc IIIC T135 °C Dc Ex ec IIC T4 Gc

Further information can be found in chapter [“2.4. Explosion protection” on page 5.](#)

North America (USA/Canada)

UL Listed for the USA and Canada	cULus certificate: E238179 Further information can be found in chapter “2.5. North America (USA/Canada)” on page 5.
FM Explosion Protection	Increased Safety for Class I, Zone 2, AEx ec IIC T4 Gc hazardous (classified) locations, indoors and outdoors (IP54). Alternatively marked as Class I Division 2 Groups A, B, C, and D; T4. Further information can be found in chapter “2.5. North America (USA/Canada)” on page 5.

Others

China Compulsory Certification (CCC)	The products with Ex approval are suitable for import and use for hazardous applications in China. Further information can be found in chapter “2.6. Others” on page 5.
--------------------------------------	---

Further information can be found in chapter [“2. Approvals and conformities” on page 5.](#)

Environment and installation

Operating conditions

Ambient temperature	- 10...+ 55 °C
Degree of protection	IP65/IP67 according to EN 60529, 4X according to NEMA 250 Standard
Operating altitude	Up to 2000 m above sea level

Installation and mechanical data

Installation position	As required, preferably with actuator in upright position
Valve actuator (type, size)	ELEMENT Type 23xx (actuator size Ø 70/90/130/225 mm) CLASSIC Type 27xx (actuator size Ø 175/225 mm)
Adapter kit	Further information can be found in chapter “Adapter kits” on page 18.

1.) The supply pressure applied must be 0.5 to 1 bar above the minimum required pilot pressure of the valve actuator.

2. Approvals and conformities

2.1. General notes

- The approvals and conformities listed below must be stated when making enquiries. This is the only way to ensure that the product complies with all required specifications.
- Not all available versions can be supplied with the below mentioned approvals or conformities.

2.2. Conformity

In accordance with the Declaration of Conformity, the product is compliant with the EU Directives.

2.3. Standards

The applied standards which are used to demonstrate compliance with the EU Directives are listed in the EU-Type Examination Certificate and/or the EU Declaration of Conformity.

2.4. Explosion protection

Approval	Description
 	Optional: Explosion protection ATEX: BVS 14 ATEX E 008 X II 3D Ex tc IIIC T135 °C Dc II 3G Ex ec IIC T4 Gc IECEx: IECEx BVS 14.0009 X Ex tc IIIC T135 °C Dc Ex ec IIC T4 Gc

2.5. North America (USA/Canada)

Approval	Description
	Optional: UL Listed for the USA and Canada The products are UL Listed for the USA and Canada according to: • UL 61010-1 (ELECTRICAL EQUIPMENT FOR MEASUREMENT, CONTROL, AND LABORATORY USE – Part 1: General Requirements) • CAN/CSA-C22.2 No. 61010-1
	Optional: FM (Factory Mutual) – Explosion Protection Increased Safety for Class I, Zone 2, AEx ec IIC T4 Gc hazardous (classified) locations, indoors and outdoors (IP54). Alternatively marked as Class I Division 2 Groups A, B, C, and D; T4.


2.6. Others

China Compulsory Certification (CCC)

Conformity	Description
	Optional: China Compulsory Certification (CCC) The products with Ex approval are suitable for import and use for hazardous applications in China.

3. Materials

3.1. Material specifications

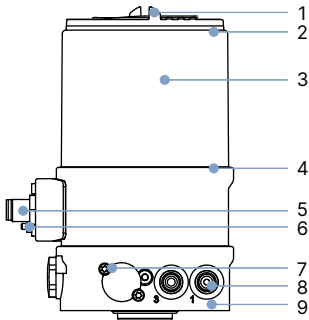


No.	Element	Material
1	Cover	PC
2	Seal	EPDM
3	Body casing	Stainless steel
4	Seal	EPDM
5	M12 plug connector	Stainless steel
6	Screws	Stainless steel
7	Screws	Stainless steel
8	Push-in connector Threaded ports G 1/8	POM/stainless steel Stainless steel
9	Basic housing	PPS

4. Dimensions


4.1. Multipole version

Note:
Dimensions in mm

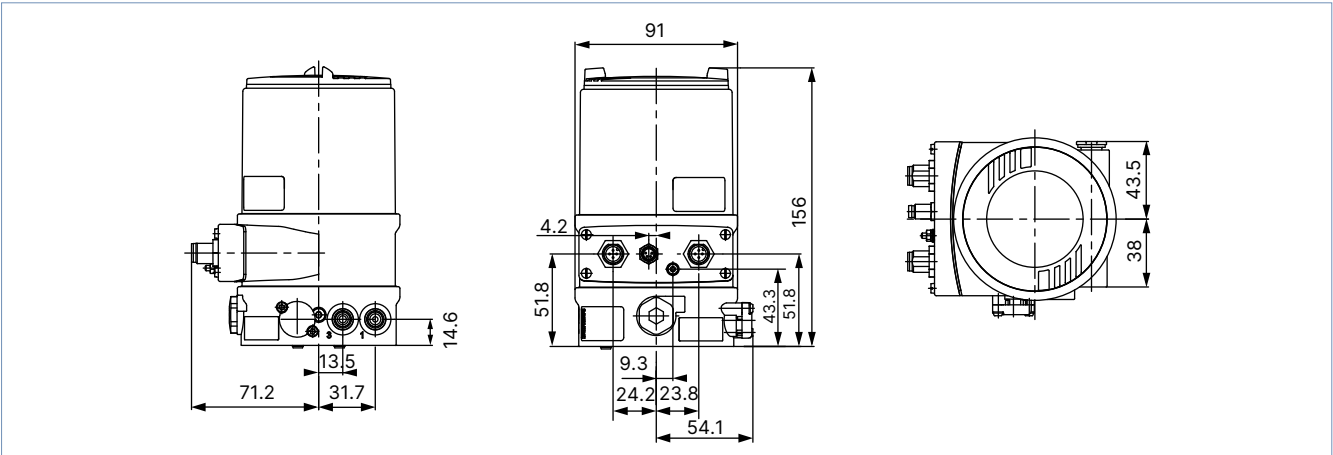


4.2. Cable gland version

Note:
Dimensions in mm

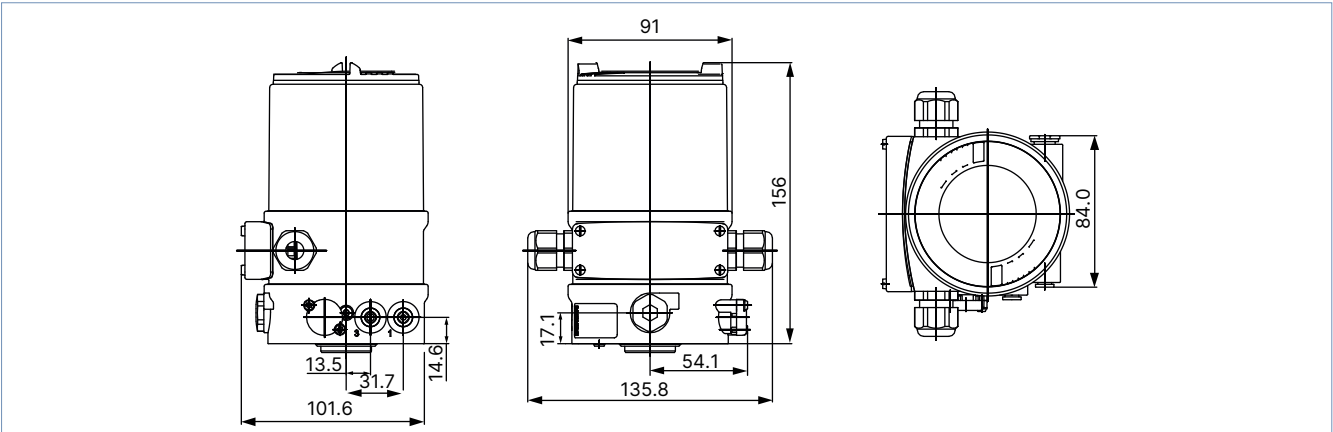

4.3. Mounting on control valves of actuator series Type 23xx, actuator size 70/90/130/225 mm**Note:**


Dimensions in mm

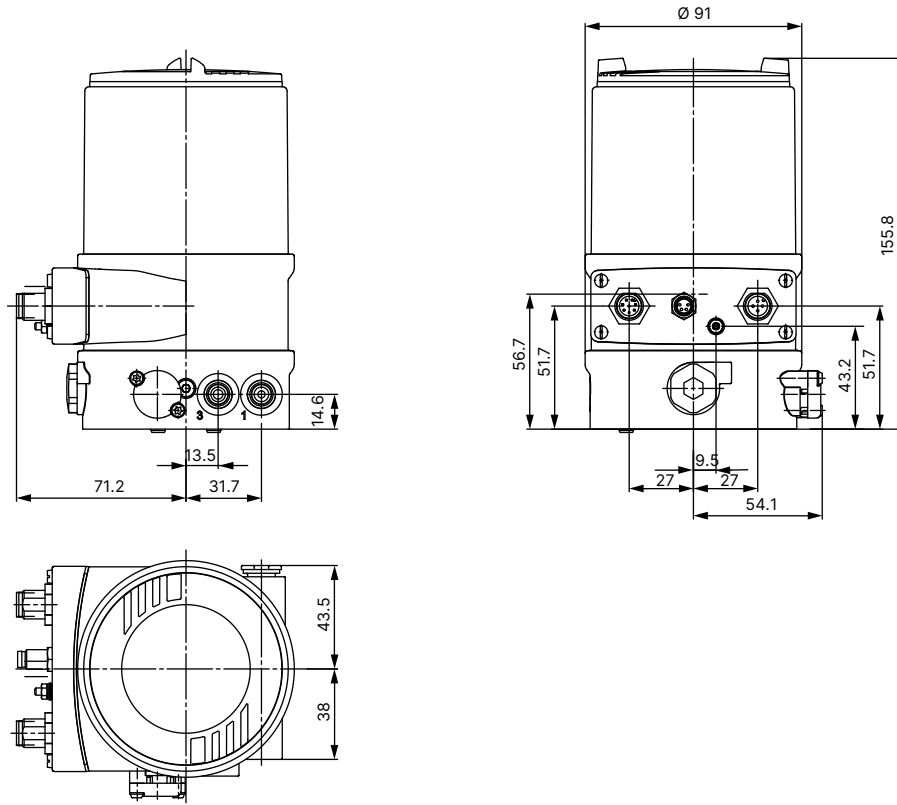

4.4. Mounting on control valves of actuator series Type 27xx, actuator size 175/225 mm

Note:


Dimensions in mm

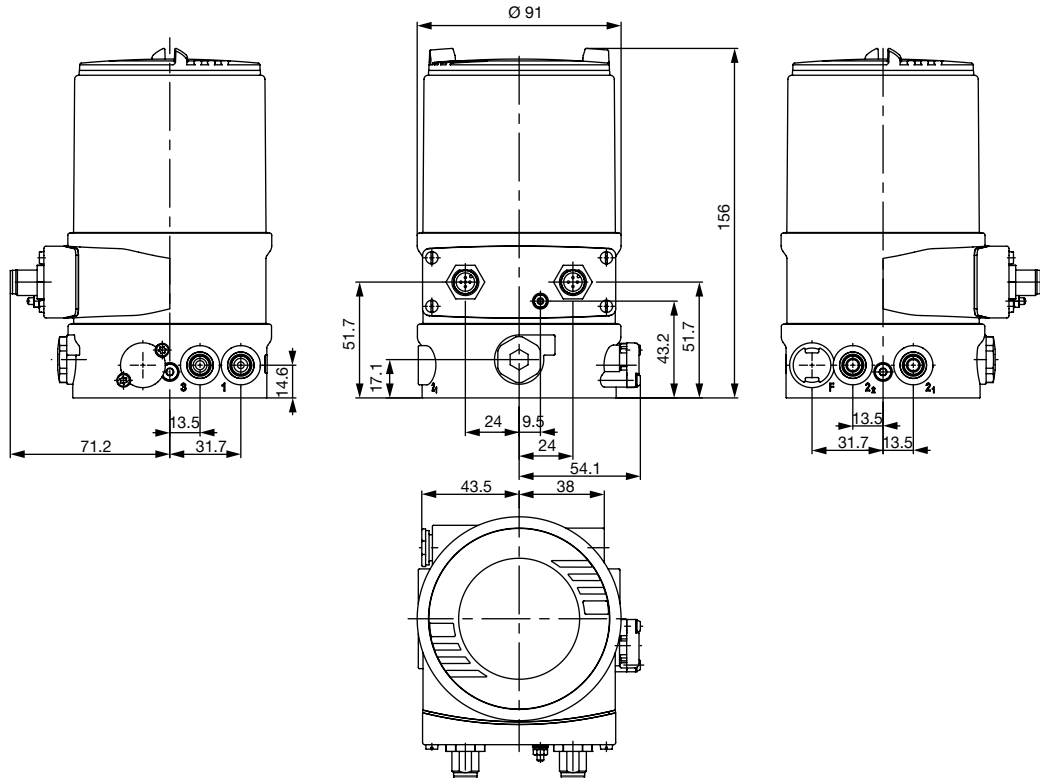

5. Device/Process connections

5.1. Electrical connections

Multipole connection

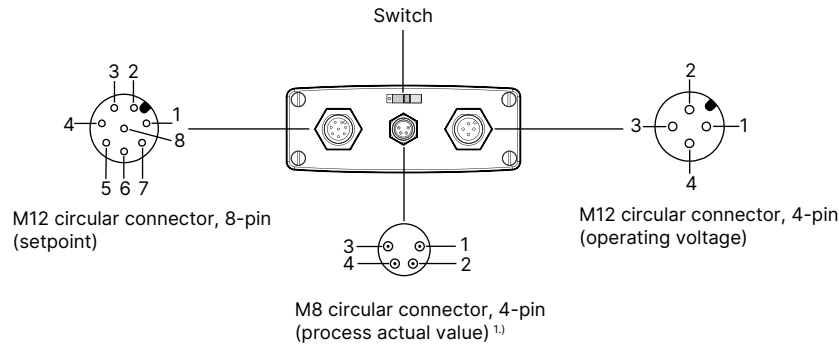

M12 circular plug, 8-pin (setpoint)		M12 circular plug, 8-pin (input/output signal) ¹⁾		M12 circular plug, 4-pin (operating voltage)	
Pin	Pin assignment	Pin	Pin assignment	Pin	Pin assignment
7	Setpoint GND	1	Digital input +	1	Operating voltage + 24 V DC
8	Setpoint + (0/4...20 mA/0...5/10 V)	2	Digital output GND	2	Not assigned
		3	Digital output 2	3	Operating voltage GND
		4	Digital output 1	4	Not assigned
		5	Analogue feedback GND		
		6	Analogue feedback +		

1.) With the options analogue feedback or digital outputs

M8 circular plug, 4-pin (process actual value)


Note:

For reasons of wire compensation connect the Pt 100 sensor via 3 wires. Always bridge Pin 3 and Pin 4 on the sensor.

Input type ¹⁾	Pin	Pin assignment	Switch
4...20 mA, internally supplied	1	+ 24 V Transmitter supply	 Switch on left
	2	Output from transmitter	
	3	GND	
	4	Bridge to GND	
4...20 mA, externally supplied	1	Not assigned	 Switch on right
	2	Process actual value +	
	3	Not assigned	
	4	Process actual value –	
Frequency, internally supplied	1	+ 24 V Sensor supply	 Switch on left
	2	Clock input +	
	3	Clock input – (GND)	
	4	Not assigned	
Frequency, externally supplied	1	Not assigned	 Switch on right
	2	Clock input +	
	3	Clock input –	
	4	Not assigned	
Pt 100 (see note above)	1	Not assigned	 Switch on right
	2	Process actual value 1 (power supply)	
	3	Process actual value 2 (GND)	
	4	Process actual value 3 (compensation)	


1.) With the options analogue feedback or digital outputs

Cable gland

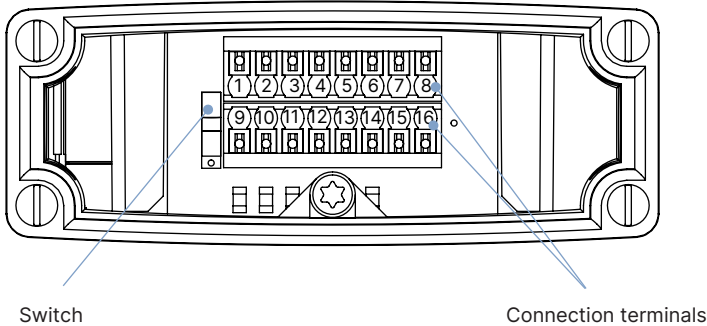

Terminal	Pin assignment
1	Analogue feedback GND
2	Analogue feedback +
3	Digital output GND
4	Digital output 2
5	Digital output 1
6	Digital input +
7	Setpoint GND
8	Setpoint +
9	Process actual value: assignment depends on sensor type, details see operating instructions
10	Type 8693 ▶
11	
12	
13	Not assigned
14	Digital input GND
15	Operating voltage GND
16	Operating voltage + 24 V


PROFIBUS DP connection

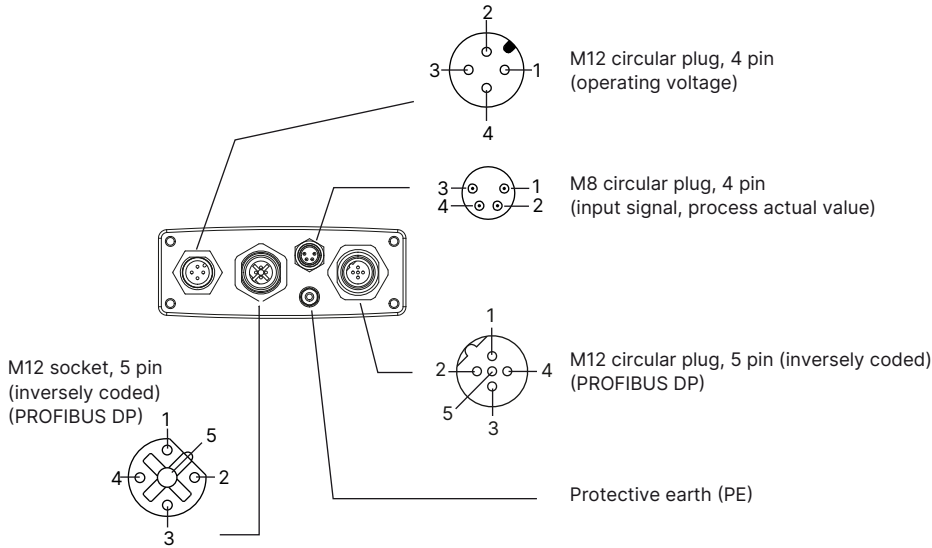

Socket/ M12 circular plug, 5-pin fieldbus connection		M12 circular plug, 4-pin operating voltage		
Pin	Pin assignment	Pin	Wire colour ^{1.)}	Pin assignment
1	VP + 5	1	Brown	Operating voltage + 24 V
2	RxD/TxD-N	2	–	Not assigned
3	DGND	3	Blue	Operating voltage GND
4	RxD/TxD-P	4	–	Not assigned
5	Not assigned			
Thread	Shielding/protective earth			

1.) The specified wire colours refer to the connection cable, which is available as an accessory with Article no. 918038.

EtherNet/IP, PROFINET, Modbus TCP connection





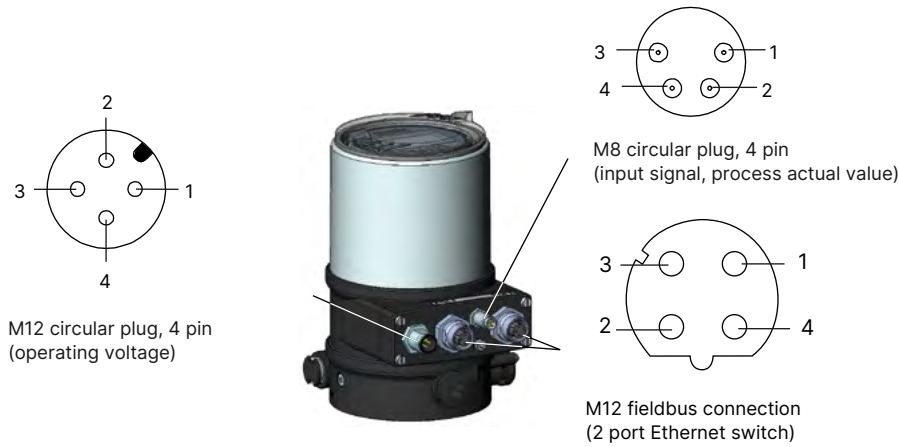


M12 circular plug, 4-pin, operating voltage			M12 fieldbus connection, D-coded		Connector diagram
Pin	Wire colour ^{1.)}	Pin assignment	Pin	Pin assignment	
1	Brown	Operating voltage + 24 V	1	Transmit +	
2	–	Not assigned	2	Receive +	
3	Blue	Operating voltage GND	3	Transmit –	
4	–	Not assigned	4	Receive –	

1.) The specified wire colours refer to the connection cable, which is available as an accessory with Article no. 918038.


M8 circular plug, 4-pin (input signal for process actual value)
Note:

For reasons of wire compensation, connect the Pt 100 sensor via 3 wires. Always bridge Pin 3 and Pin 4 on the sensor.

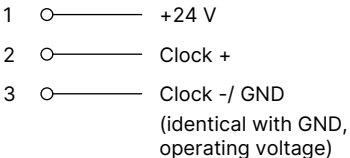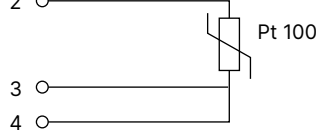Input type ^{1.)}	Pin	Wire colour ^{2.)}	Pin assignment	Switch	Outer circuitry
4...20 mA - internally supplied	1	Brown	+ 24 V Transmitter supply	 Switch on left	
	2	White	Output from transmitter		
	3	Blue	GND (identical to GND operating voltage)		
	4	Black	Bridge according to GND (GND from 3 guide transmitter)		
4...20 mA - externally supplied	1	Brown	Not assigned	 Switch on right	
	2	White	Process actual value +		
	3	Blue	Not assigned		
	4	Black	Process actual value -		
Frequency - internally supplied	1	Brown	+ 24 V sensor supply	 Switch on left	
	2	White	Clock input +		
	3	Blue	Clock input - (GND)		
	4	Black	Not assigned		
Frequency - externally supplied	1	Brown	Not assigned	 Switch on right	
	2	White	Clock input +		
	3	Blue	Clock input -		
	4	Black	Not assigned		
Pt 100 (see note above)	1	Brown	Not assigned	 Switch on right	
	2	White	Process actual value 1 (power supply)		
	3	Blue	Process actual value 3 (GND)		
	4	Black	Process actual value 2 (compensation)		

1.) Can be adjusted via software (see **operating instructions Type 8692/8693** ▶ "24.2.1 PV-INPUT – Setting up the process controller")

2.) The specified wire colours refer to the connection cable, which is available as an accessory with Article no. 264602.

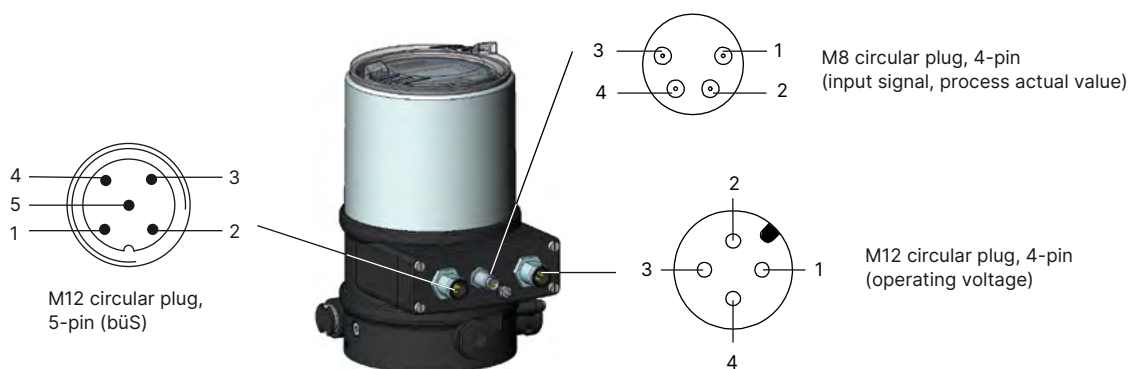Bürkert system bus (bÜS) connection


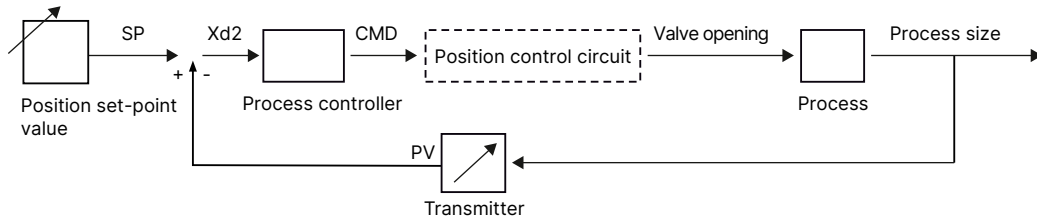
M12 circular plug × 1, 5-pin (bÜS connection)			M12 circular plug, 4-pin (operating voltage)		
Pin	Wire colour	Pin assignment	Pin	Wire colour ^{1.)}	Pin assignment
1	CAN shielding	CAN shielding	1	Brown	Operating voltage + 24 V DC
2	–	Not assigned	2	–	Not assigned
3	Black	GND / CAN_GND	3	Blue	Operating voltage GND
4	White	CAN_H	4	–	Not assigned
5	Blue	CAN_L			

1.) The specified wire colours refer to the connection cable, which is available as an accessory with Article no. 918038.


6. Performance specifications

6.1. Signal flow diagram

Process control circuit



Position control loop

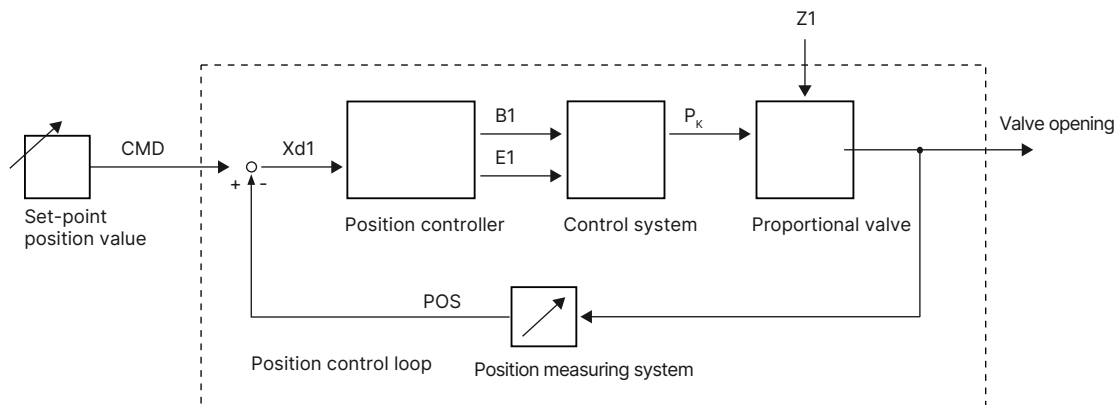

Additional software options of the TopControl process controller Type 8693


- Automatic commissioning of control valve systems
- Automatic parameterisation of process control circuit
- Automatic or manual characteristic curves selection
- Setting of seal and maximum stroke threshold, respectively
- Parameterisation of positioner
- Manual parameterisation of process controller
- Limitation of stroke range
- Limitation of positioning speed
- Setting direction of movement
- Configuration of digital input
- Signal range splitting on several controllers
- Configuration of 1 analogue or 2 digital outputs
- Signal fault detection
- Safety position
- Code protection
- Contrast inversion of display
- Language selection
- Parameterisable diagnostic functions¹⁾ / digital outputs (option)
 - Operating hours counter
 - Path accumulator
 - Monitoring of process actual value
 - Position monitoring
 - Monitoring of mechanical end positions in the armature

- Graphical display of dwell time density and movement range
- Direction-reversal counter
- Temperature monitoring

1.) Further information on each diagnostic function with detailed description can be found in the **operating instructions Type 8693** ►


6.2. Interface diagram

Version without fieldbus communication

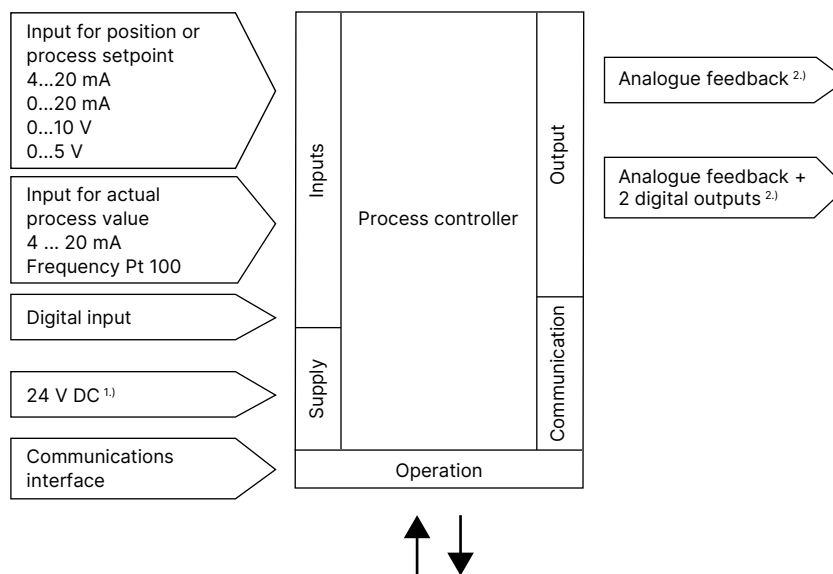

Version with fieldbus communication

With PROFIBUS DP, EtherNet/IP, PROFINET, Modbus TCP and Bürkert system bus (büS)

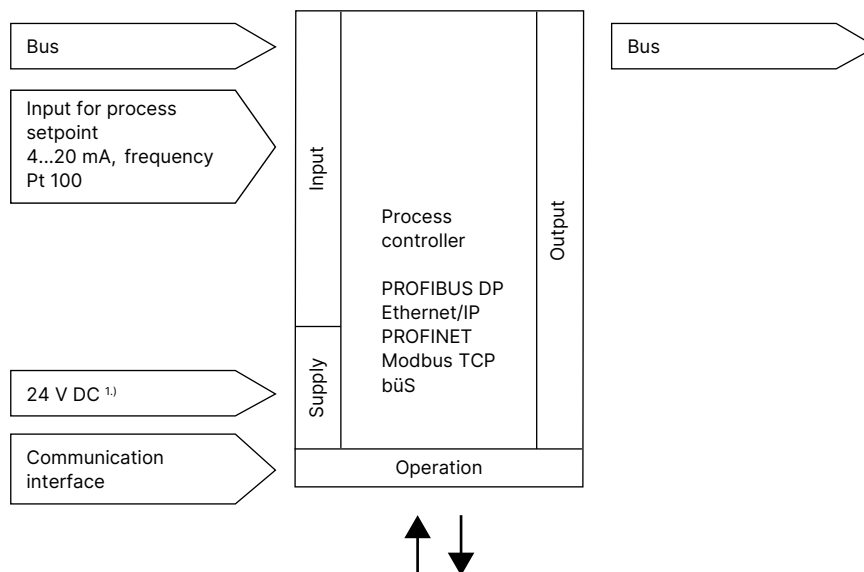

1.) The operating voltage is supplied with a 3-wire unit independent from the setpoint signal.

2.) Alternative options

7. Product installation

7.1. Combination options with pneumatic process valves

Note:

A **TopControl control valve system** consists of a **process controller Type 8693** and an **ELEMENT control valve Type 23xx**, resp. **Type 2103**.

The following information is required to select a complete system:

- **Article no.** of the desired **process controller TopControl**, see **data sheet Type 8693**
- **Article no.** of the desired **control valve Type 23xx / 2103**, see **data sheet Type 2301 ▶**, **Type 2300 ▶** and **Type 2103 ▶**

You order two components and receive a completely assembled and tested valve.

Example of variations of the control valve system

Process controller	Pneumatic process control valves			
				
Type 8693	Type 2301 ▶ Globe valve	Type 2300 ▶ Angle seat valve	Type 2103 ▶ Diaphragm valve	Hygienic process valve (third-party)
Control valve system				
				
Type 8802-GD-J Control valve system ELEMENT 2301 + 8693	Type 8802-YG-J Control valve system ELEMENT 2300 + 8693	Type 8802-DF-J Control valve system ELEMENT 2103 + 8693	Mounting on third- party actuators ^{1.)}	

1.) See data sheet **Adaptations for third-party actuators Type KK01 ▶** or contact the appropriate Bürkert sales office.

8. Ordering information

8.1. Bürkert eShop



Bürkert eShop – Easy ordering and quick delivery

You want to find your desired Bürkert product or spare part quickly and order directly? Our online shop is available for you 24/7. Sign up and enjoy all the benefits.

[Order online now](#)

8.2. Bürkert product filter



Bürkert product filter – Get quickly to the right product

You want to select products comfortably based on your technical requirements? Use the Bürkert product filter and find suitable articles for your application quickly and easily.

[Try out our product filter](#)

8.3. Ordering chart

Note:

- All standard versions are UL-approved.
- The following applies to all of the following variants: pilot air port socket connection G 1/8.

Circuit function Pilot valve system	Communication	Electrical connections	Analogue feedback 0/4...20 mA	Analogue feedback 0/4...20 mA + 2 digital outputs	Diagnos- tics ¹⁾	Digital input	Article no.	
							Standard	ATEX II Cat. 3G/D, IECEx, CCC ²⁾
Actuator series Type 23xx, actuator size Ø 70/90 mm								
Low air capacity, single- acting	Without fieldbus communication	Cable gland	–	–	–	Yes	306936 	306990 
			–	Yes	Yes	Yes	306965 	306991 
		M12 plug connector	–	–		Yes	307082 	307103 
			–	Yes	Yes	Yes	307105 	307104 
	PROFIBUS DP-V1	M12 plug connector	Via bus	–	–	–	311800 	311801 
	EtherNet/IP		Via bus	Yes	Yes	–	306867 	306865 
	PROFINET		Via bus	Yes	Yes	–	306871 	306869 
	Modbus TCP		Via bus	Yes	Yes	–	306876 	306874 
Bürkert system bus (büS)	M12 plug connector	Via bus	–	Yes	–	306881 	306878 	
Low air capacity, double- acting	Without fieldbus communication	Cable gland	–	–		Yes	306931 	306992 
			–	Yes	Yes	Yes	306994 	306993 
		M12 plug connector	–	–		Yes	307107 	307109 
			–	Yes	Yes	Yes	307108 	307110 
	PROFIBUS DP-V1	M12 plug connector	Via bus	–	–	–	311802 	311803 

Circuit function Pilot valve system	Communication	Electrical connections	Analogue feedback 0/4...20 mA	Analogue feedback 0/4...20 mA + 2 digital outputs	Diagnosis ¹⁾	Digital input	Article no.	
							Standard	ATEX II Cat. 3G/D, IECEx, CCC ²⁾
Actuator series Type 23xx, actuator size Ø 130/225 mm								
High air capacity, single-acting	Without fieldbus communication	Cable gland	–	–		Yes	306946 	306995 
			–	Yes	Yes	Yes	306973 	306997 
	M12 plug connector	–	–		Yes	307112 	307114 	
		–	Yes	Yes	Yes	307113 	307115 	
		Via bus	–	–	–	311804 	311805 	
		Via bus	–	Yes	–	306868 	306866 	
		Via bus	–	Yes	–	306872 	306870 	
		Via bus	–	Yes	–	306877 	306875 	
		Via bus	–	Yes	–	306882 	306880 	
Actuator series Type 27xx, actuator size Ø 175/225 mm								
High air capacity, single-acting	Without fieldbus communication	Cable gland	–	–		Yes	306950 	307003 
			–	Yes	Yes	Yes	306952 	307004 
	M12 plug connector	–	–		Yes	307068 	307121 	
		–	Yes	Yes	Yes	307070 	307122 	
		Via bus	–	–	–	233356 	265138 	
		Via bus	–	Yes	–	313276 	313275 	
		Via bus	–	Yes	–	313269 	313268 	
		Via bus	–	Yes	–	313271 	313270 	
		Via bus	–	Yes		313283 	313282 	

1.) See "Additional software options of the TopControl process controller Type 8693" on page 13

2.) CCC (China Compulsory Certificate) for device versions with Ex approval

Further versions on request

**Additional**

EtherNet/IP, PROFINET, Modbus TCP and bÜS (Bürkert System Bus): double-acting versions with low air capacity

8.4. Ordering chart accessories

Standard accessories

Note:

Must be ordered separately.

Description	Article no.
M12 circular socket with cable, 8-pin, cable length: 5 m, for input and output signals	919267 
M12 circular socket with cable, 4-pin, cable length: 5 m, for power supply (without communication)	918038 
M8 circular socket with cable, 4-pin, cable length: 5 m, for process actual value of sensor	264602 
USB bÜS interface set 2 (Type 8923) for connection to the Bürkert Communicator software: including bÜS stick, connection cable to M12 plug, M12 connection cable on micro USB for the bÜS service interface and Y distributor, cable length: 0.7 m	772551 
bÜS cable extension, M12, cable length: 1 m	772404 
bÜS cable extension, M12, cable length: 3 m	772405 
bÜS cable extension, M12, cable length: 5 m	772406 
bÜS cable extension, M12, cable length: 10 m	772407 
Silencer G 1/8	780779 
Sensor puck (spare part)	682240 
USB interface for serial communication	227093 
Bürkert Communicator Software	Type 8920 

Adapter kits

Note:

Must be ordered separately.

Adapter kits for third-party actuators can be found in the **data sheet Adaptation for third-party actuators Type KK01**  or contact the appropriate Bürkert sales office.

Description	Actuator size	Control function	Article no.
Attachment kit for Type 21xx/23xx actuator series	Ø 70/90/130 mm	Universal	679917 
Attachment kit for Type 21xx/23xx actuator series	Ø 225 mm	Universal	60025906 
Attachment kit for Type 27xx actuator series	Ø 175/225 mm	A (NO), B (NC)	679935 